
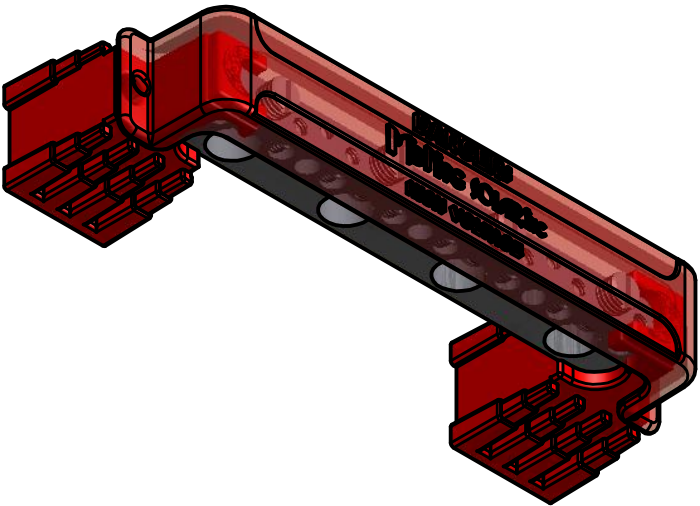
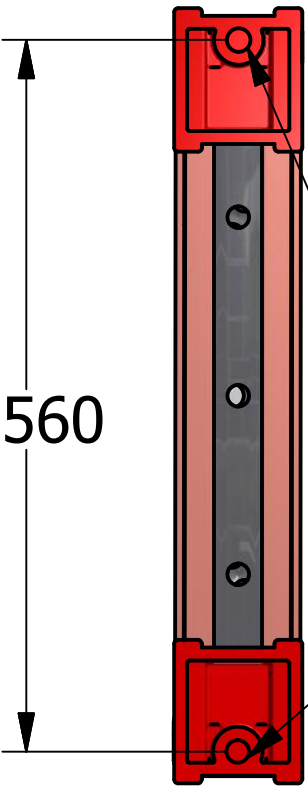


REVISION HISTORY			
REV.	DESCRIPTION OF CHANGE	DATE	SIGN

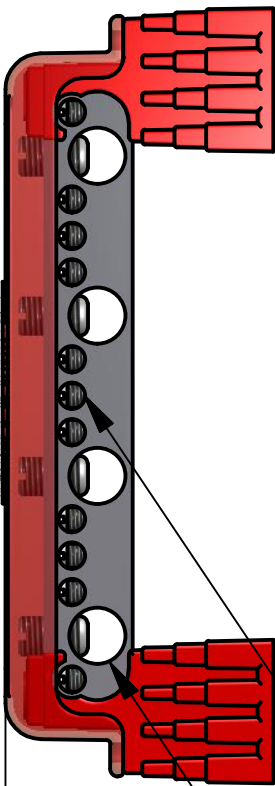

6.06

5.560

1.00

2.09

10-32 THREADED INSERT

14-6 AWG ELEVEN PLACES

2/0 AWG FOUR PLACES

INSULATED BUSBAR
250 AMP / 600 VOLT
NYLON BASE, ABS SNAP ON COVER
UL & CSA 90C ALUMINUM & COPPER

ALL TOLERANCES, UNLESS OTHERWISE STATED: x.xxx=+/-0.005" x.xx=+/-0.01" x.x=+/-0.05" ALL ANGLES =+/- 1° UNLESS OTHERWISE STATED		DRAWN Robin	6/29/2014	MIDNITE SOLAR, INC 			
		CHECKED					
		QA		MidNite Solar			
		MFG					
MATERIAL:	STANDARDS:	APPROVED		SIZE B	PROJECT: MNXX	DWG NO MNTBB2-15	REV
FINISH:							
PROCESS:				E-FILE:mntbb2-15.iam			
				SHEET 1 OF 1			